



CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Certificate No.: CE220302007709

Product

AC contactor

Applicant

Zhejiang Tengen Electric Co.,Ltd.

Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang
Province, P.R.China

Type/Model

TGCA-7511,TGCA-7511N,TGCA-8511,TGCA-8511N,TGC
A-10011,TGCA-10011N

Technical data

See the attachment

This is to certify that, on the basis of the tests undertaken as per Report No.
03601-A-25D0037-S, the submitted sample(s) of the above item complies with:

EN IEC 60947-4-1:2019

and fulfills testing requirements of the European Directive:

2014/35/EU

This report is to verify the compliance of the sample submitted by the manufacturer only,
and does not include the manufacturing process. Users shall affix the mark in accordance
with the related legislation.

Valid from: Apr.28,2025

Valid until: Apr.27,2028

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE



CHINA QUALITY CERTIFICATION CENTRE CO., LTD.

CERTIFICATE OF CONFORMITY

Appendix

Page 1 of 2

Certificate No.: CE220302007709

TGCA-7511, TGCA-7511N, TGCA-8511, TGCA-8511N, TGCA-10011, TGCA-10011N

Ui:690V;Uimp:8kV;

Ith: TGCA-7511, TGCA-7511N:90A;

TGCA-8511, TGCA-8511N:100A;

TGCA-10011, TGCA-10011N:110A;

Ui:690V;Uimp:8kV;

AC-1:

TGCA-7511, TGCA-7511N:Ue/Ie:220V/230V,380V/400V/90A;

TGCA-8511, TGCA-8511N:Ue/Ie:220V/230V,380V/400V/100A;

TGCA-10011, TGCA-10011N :Ue/Ie:220V/230V,380V/400V/110A;

AC-3: TGCA-7511:Ue/Ie:220V/230V/75A ;380V/400V/75A; 660V/690V/42A;

TGCA-8511 :Ue/Ie: 220V/230V/85A;380V/400V/85A; 660V/690V/49A;

TGCA-10011 :Ue/Ie: 220V/230V/100A;380V/400V/100A; 660V/690V/49A;

AC-4:

TGCA-7511, TGCA-7511N:Ue/Ie:220V/230V/37A;380V/400V/37A;660V/690V/17.3A;

TGCA-8511, TGCA-8511N : Ue/Ie:220V/230V/44A;380V/400V/44A;660V/690V/21.3A;

TGCA-10011, TGCA-10011N: Ue/Ie:220V/230V/54A;380V/400V/54A;660V/690V/27A;

Us: AC24V,AC36V,AC48V,AC110V,AC220V,AC380V,AC400V,AC415V,50Hz;

AC24V,AC36V,AC48V,AC110V,AC220V,AC380V,AC400V,AC415V, 50/60Hz;

Utilization category:AC-1, AC-3,AC-4;

Number of poles:3P;

IP20;

Attached auxiliary contact: 1NO,1NC,2sets; Ith:10A;Ui:690V;Uimp:6kV;

AC-15:1.6A/220V,0.95A/380V, DC-13:0.15A/220V.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE




CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Appendix

Page 2 of 2

Certificate No.: CE220302007709

Explanation of model/type

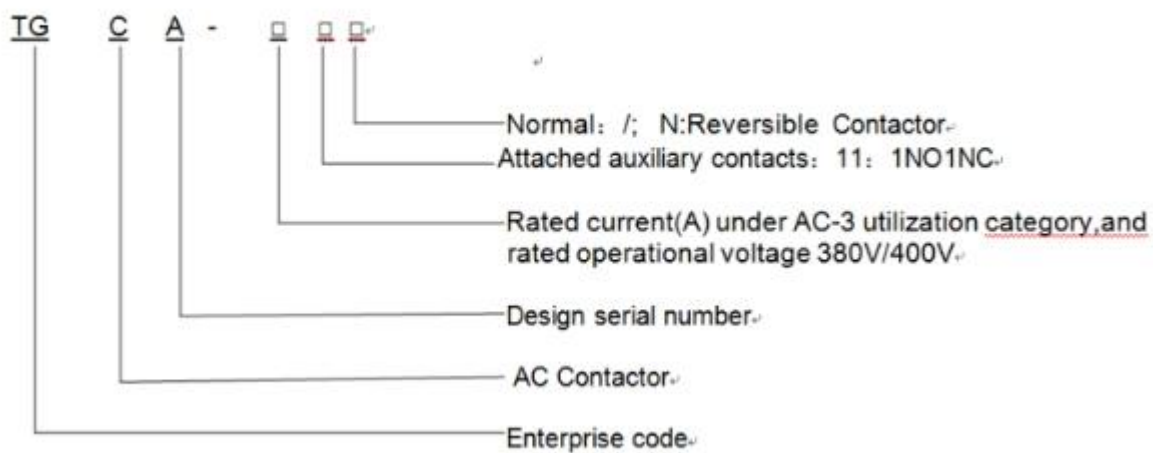

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE